


Fire Department Process for New Construction Flow Chart

Fire Protection Sprinkler and Alarm System

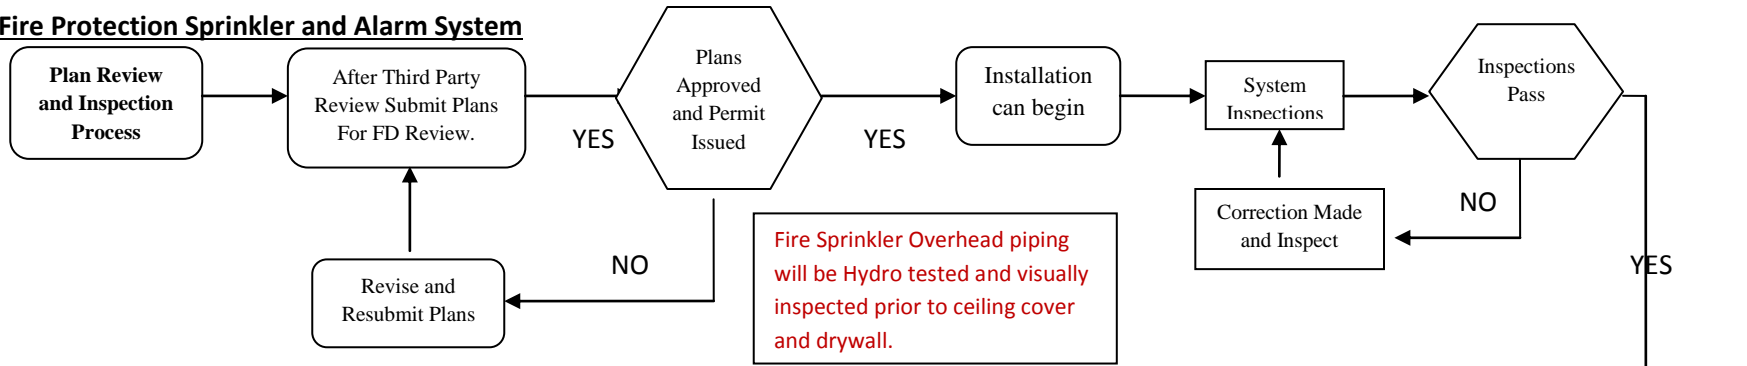

Fire Sprinkler Overhead piping will be Hydro tested and visually inspected prior to ceiling cover and drywall.

Please see Guidelines for Fire Alarm and Fire Sprinkler Inspections.

Underground Fire Main Hydro, Visual and Flush shall be inspected as one inspection prior to covering.

All Fire Protection Systems shall be 100% inspected and passed prior to FD Final Inspection

This flow chart is intended as a guide to understand the role of the Fire Department with regards to new construction and the permitting and inspection process. Please refer to each individual fire protection process flow chart for information regarding the individual systems requirements.

Based upon the uniqueness of each project, your project may or may not deviate from this typical path. It is recommended that you meet with the Fire Marshal's Office to discuss your project in detail prior to vertical construction on site.

It is the intent of the Paris Fire Department to assist the General Contractor in the permit and inspection process in order to be successful in Fire and Life Safety issues.